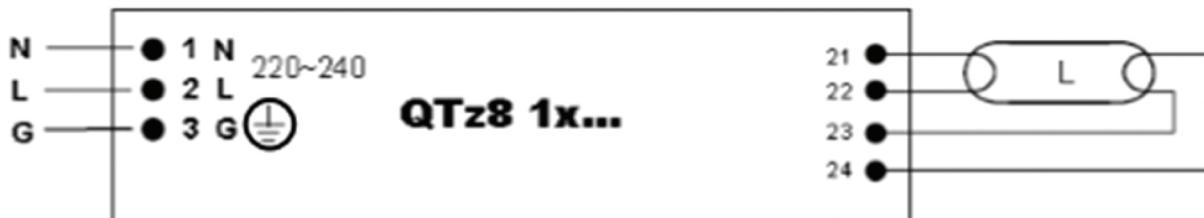


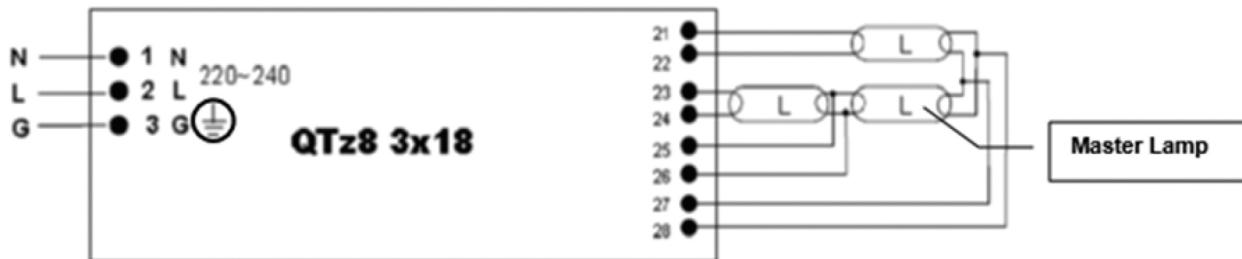
	QTz8 1x18	QTz8 1x36	QTz8 2x18	QTz8 2x36	QTz8 3x18	QTz8 4x18
10A (B)	34 x	34 x	34 x	15 x	15 x	15 x
16A (B/C)	56 / 94 x	56 / 94 x	56 / 94 x	25 / 40 x	25 / 40 x	25 / 40 x
A	≤ 20 A	≤ 20 A	≤ 20 A	≤ 23 A	≤ 23 A	≤ 23 A
T _H	130 µs	130 µs	130 µs	250 µs	250 µs	250 µs

QTz8 1x...

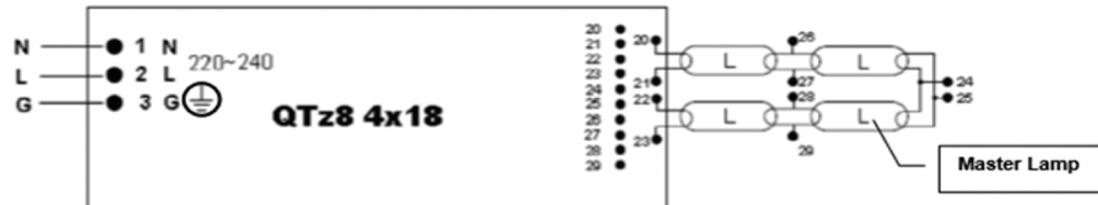
Max. permitted cable length in between ECG and lamp: 1.0 m (PIN 21, 22); 2.0 m (PIN 23, 24)

QTz8 2x...

Max. permitted cable length in between ECG and lamp: 1.0 m (PIN 21, 22, 23, 24); 2.0 m (PIN 25, 26)

QTz8 3x

Max. Permitted cable length in between ECG and lamp: 1.0 m (PIN 21, 22, 23, 24); 2.0 m (PIN 25, 26, 27, 28)

QTz8 4x

Max. Permitted cable length in between ECG and lamp: 1.0 m (PIN 20, 21, 22, 23); 2.0 m (PIN 24, 25, 26, 27, 28, 29)